BAE SYSTEMS Environmental Services

Site	Trial Pit Number
Bishopton	TP L

Excavation Method	Dimensions	Ground Level (mOD)	Client	Job Number
Trial Pit			BAE SYSTEMS Properties Ltd/Redrow Commercial Developments Ltd	P501-OD
	Location	**Dates** 24/03/2003	**Engineer** BAE SYSTEMS Environmental Services	**Sheet** 1/1

Depth (m)	Sample / Tests	Water Depth (m)	Field Records	Level (mOD)	Depth (m) (Thickness)	Description	Legend	Water
					(0.10) 0.10	MADE GROUND: Friable brown sandy clay, with occasional brick fragments		
					(0.50)	MADE GROUND: Fine grey with brown mottling, well fissured sandy clay, with much weathered sandstone and occasional brick fragments.		
0.50	S1				0.60	MADE GROUND: Fine grey with brown mottling, well fissured sandy clay, with much weathered sandstone and occasional brick fragments, becoming predominantly weathered sandstone at 0.6m with sandy clay along fissures		
					(1.40)			
2.00	S2				2.00	Complete at 2.00m		

Plan

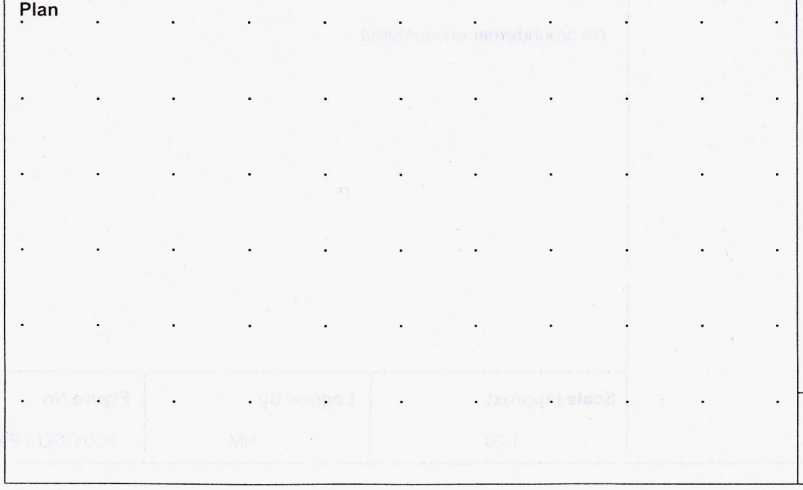

Remarks

No groundwater encountered
Pit sides unstable

Scale (approx)	Logged By	Figure No.
1:20	SR	P501-OD.TP L